


# CITY OF AUBURNDALE

## POTABLE WATER BACK FLOW PREVENTION

CONCRETE PAD

PLAN

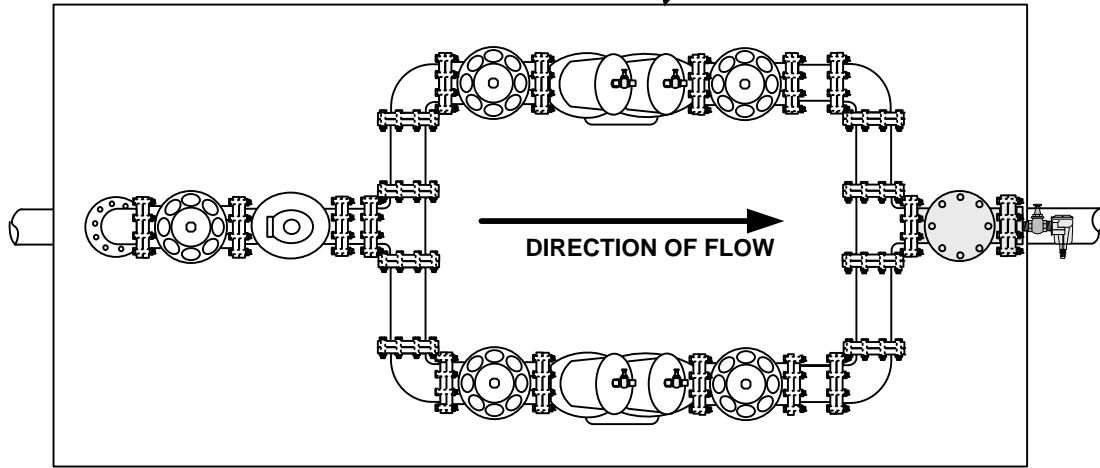


REDUCED PRESSURE BACK FLOW PREVENTORS (BRONZE)

2-1/2" THRU 10" (2 REQ.)

WATER METER (1 REQ.)

VALVES (5 REQ.)

INSTALL TEE, COMPANION FLANGE, VALVE AND FREEZE PREVENTION DEVICE

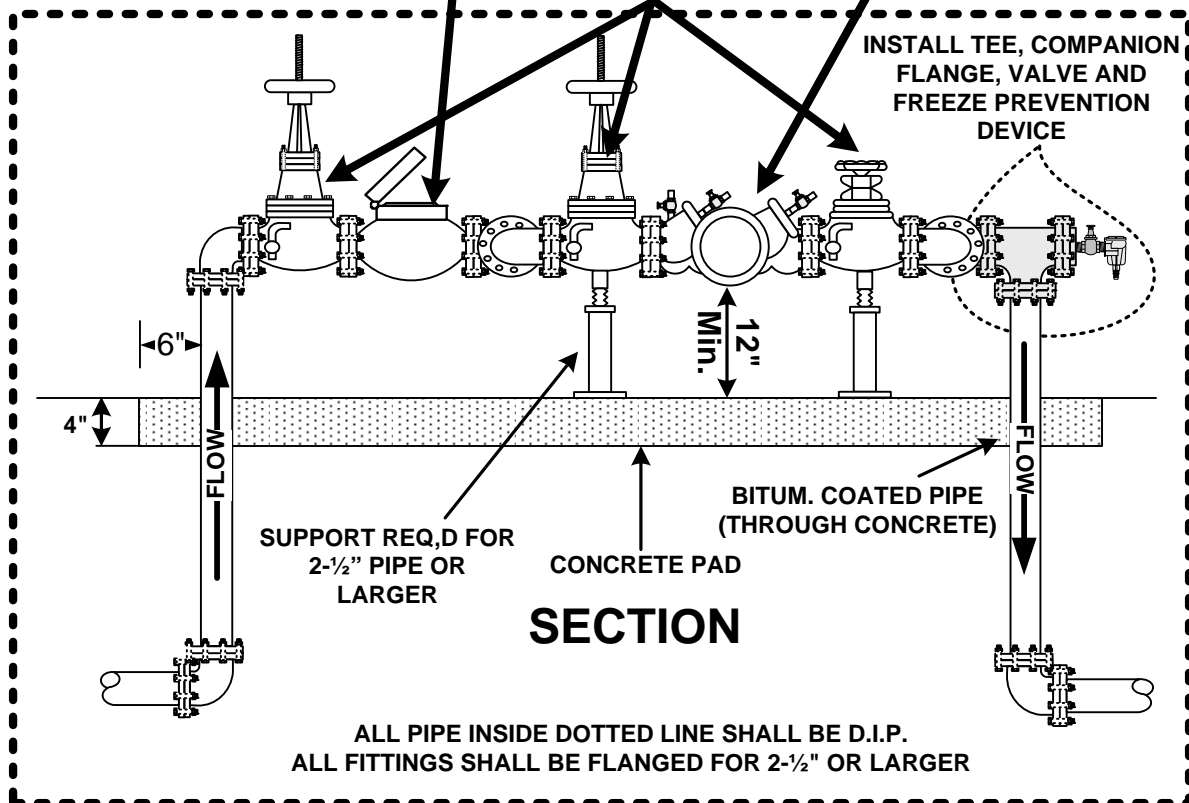

SECTION

ALL PIPE INSIDE DOTTED LINE SHALL BE D.I.P.  
ALL FITTINGS SHALL BE FLANGED FOR 2-1/2" OR LARGER